

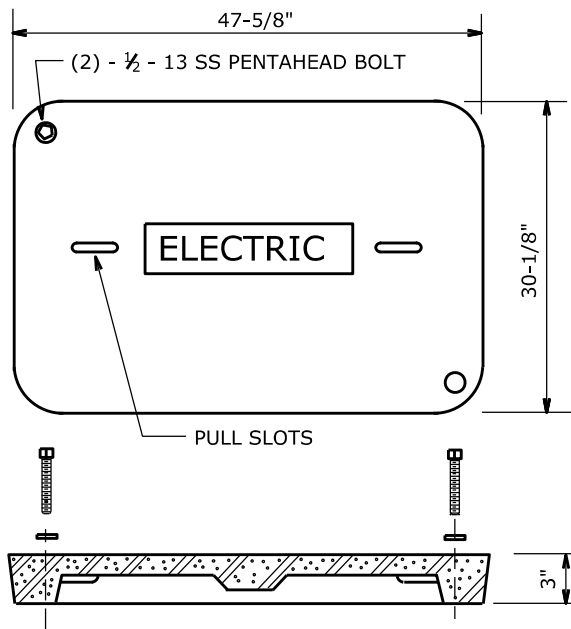
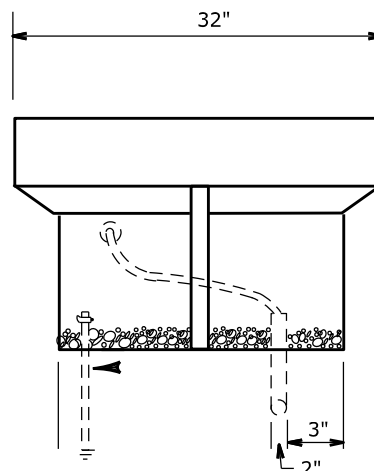


NOTES:

1. THIS BOX MAY BE USED FOR MULTIPLE RUNS OF SECONDARY CONDUCTOR OR FOR TWO (2) SINGLE-PHASE PRIMARY CONDUCTORS.
2. ACCEPTABLE FOR LIGHT TRAFFIC. H-10 RATED(10,400 LBS. OR LESS).
3. FOR PLACEMENT OF CONDUITS ON SECONDARY CONNECTIONS SEE SPECIFICATIONS 9-5.
4. USE CURB MARKER TEC NO. 2005212 ON CURB TO INDICATE MANHOLE/HANDHOLE LOCATION. CURB MARKERS SHOULD BE INSTALLED USING ADHESIVE TEC NO. 2007225.
5. INSTALL GROUND ROD INSIDE ONE OF THE FOUR (4) CORNERS OF THE BOX. GROUND ROD SHALL BE INSTALLED TO A DEPTH OF 40 FEET. USE FOUR (4) TEN FOOT (10;) RODS, WITH FOUR INCHES (4") EXPOSED ABOVE THE GRAVEL. IF 40' IS NOT POSSIBLE, CUT THE LAST ROD FOUR INCHES (4") ABOVE THE GRAVEL TO ALLOW CONNECTIONS. INDICATE THE DEPTH ACHIEVED ON THE WORK REQUEST.

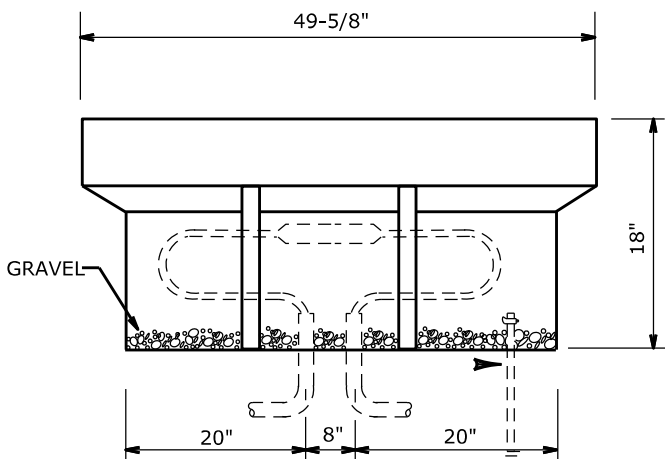

COVER

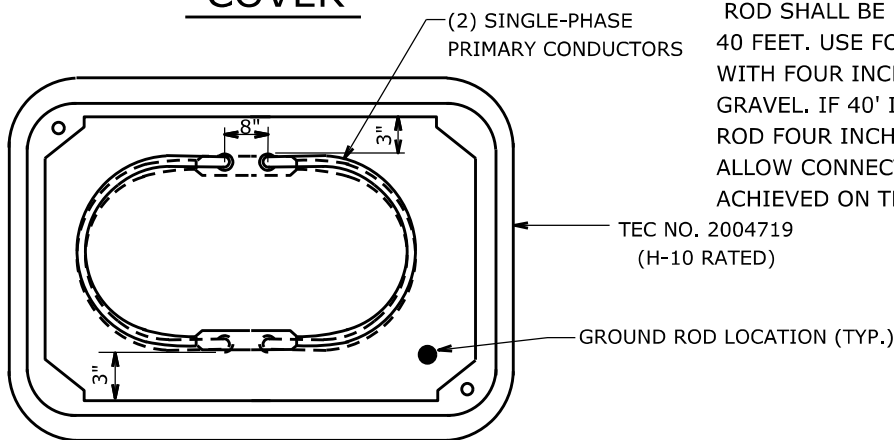

◀ DENOTES LATEST REVISION

NO.	CK'D	DATE	REVISION
4	WWD	5-2-23	ADD GROUND RODS, REMOVE SECOND CABLE
3	RGH	6-29-20	REMOVED "TEC" FROM NOTE 5. ADDED GRAVEL TO BOTTOM OF BOX
2	SWM	8-18-05	ADDED DIMENSIONS
1	SWM	8-18-05	REVISED NOTE 1 & REF. BLOCK, ADDED ANOTHER PRIMARY

30" X 48" X 18"

SPLICEBOX/LIGHT TRAFFIC HANDHOLE

MGR: STD'S
APPR. DATE 5-2-23
SUPERSEDES 6-21/8-18-05