




REFERENCES  
GR&S UG.  
STD. 1-19

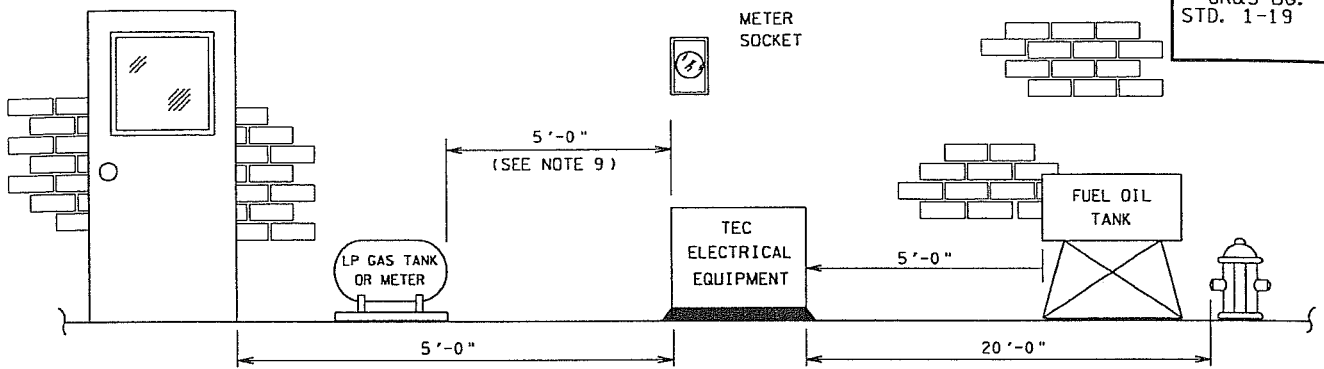

ELEVATION

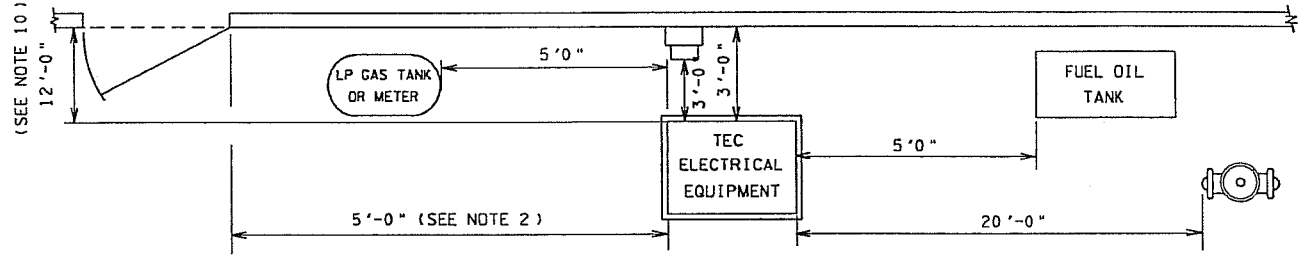

PLAN VIEW

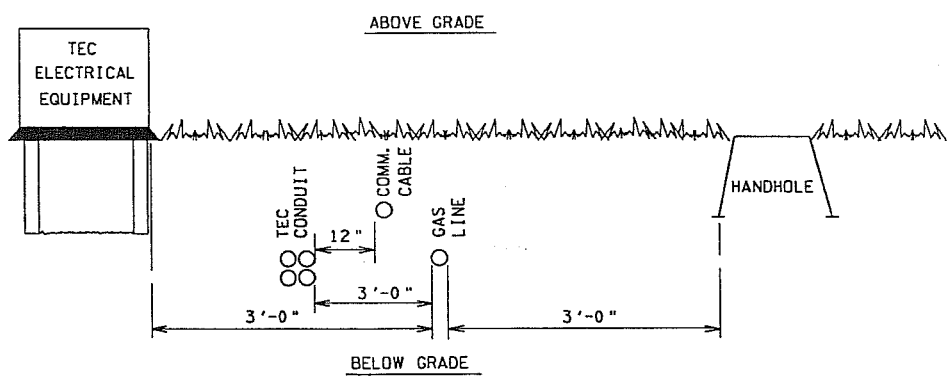

BELOW GRADE

NOTES:

1. ALL DIMENSIONS SHOWN ARE MINIMUM.
2. THIS DIMENSION ALSO APPLIES TO OPEN STAIRWAYS.
3. THERE SHALL BE NO PIPING OR CONDUIT UNDER THE PAD OTHER THAN THOSE REQUIRED TO CONNECT THE EQUIPMENT.
4. NO PORTION OF THE BUILDING SHALL EXTEND OVER EQUIPMENT, OTHER THAN METER EQUIPMENT.
5. ADEQUATE PASSAGEWAYS TO ACCOMMODATE TRUCKS OR OTHER NECESSARY LIFTING AND HAULING EQUIPMENT SHALL BE PROVIDED TO ALLOW FOR EQUIPMENT REPLACEMENT.
6. THE EQUIPMENT SHALL BE INSTALLED SO THAT THE FRONT OF THE UNIT FACES AWAY FROM THE BUILDING.
7. THERE SHALL BE NO ABOVE GROUND OBSTRUCTIONS SUCH AS COOLING TOWERS, SHRUBS, PLANTS, FENCES, ETC. WITHIN 10'-0" OF THE FRONT OF THE EQUIPMENT, OR WITHIN 3'-0" OF THE SIDES OR BACK.
8. THE 20'-0" MINIMUM DIMENSION TO THE FIRE HYDRANT ALSO APPLIES TO FIRE ESCAPES.
9. 5'-0" DIMENSION ALSO PERTAINS TO LP GAS PIPELINE CONNECTIONS, VALVES, OR GAUGES.
10. THIS 12'-0" DIMENSION APPLIES TO EQUIPMENT PLACED IN FRONT OF DOORS OR OPEN STAIRWAYS.
11. PRIMARY CABLES WILL NOT BE PERMITTED UNDER BUILDINGS AND STRUCTURES.

GR&S 3-20

◀ DENOTES LATEST REVISION

NO.	CK'D	DATE	REVISION
3			
2	RAS	9-20-07	ADDED NEW NOTE 11
1	REM	10-16-03	ADDED COMM. CABLE

MGR, STD'S  
APPR. DATE  
SUPERSEDES

*Bob Shieling*  
9-20-07  
1-16/10-16-03

## LOCATION OF NON-OIL FILLED ELECTRICAL EQUIPMENT

1-16

TAMPA ELECTRIC CO.

STANDARDS

GENERAL RULES & SPECIFICATIONS UG.