


REFERENCES	
GR&S UG	
SEC. 1	
SEC. 11	
SEC. 12	

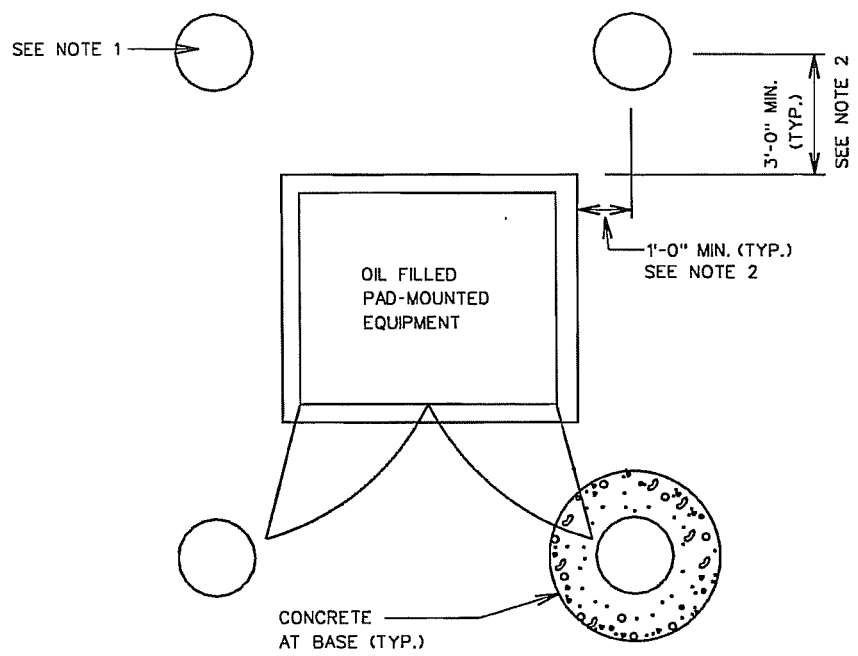


TOP VIEW

FILL & ROUND OFF WITH CONCRETE

6" SCHEDULE 40 GALVANIZED
TEC NO. 6102201

PAINT WITH BLACK ENAMEL

YELLOW REFLECTIVE TAPE
TEC NO. 6805165

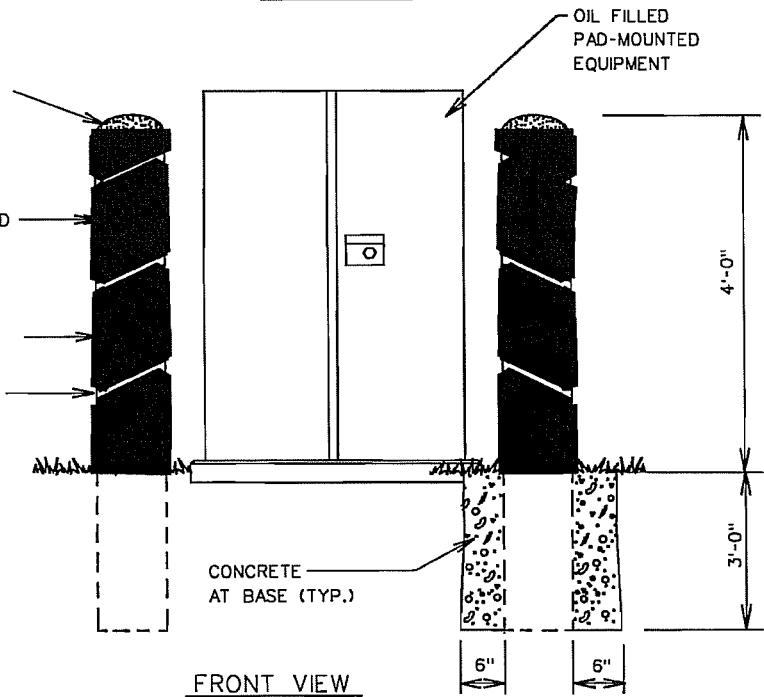

FRONT VIEW

NOTES:

- UP TO 4 BOLLARDS SHOULD BE INSTALLED AROUND PERIMETER WHEN OIL FILLED PAD-MOUNTED EQUIPMENT IS LOCATED IN ANY AREA ACCESSIBLE TO VEHICLES FOR PROTECTION OF AREAS THAT COULD BECOME CONTAMINATED WITH MINERAL OIL SUCH AS : DRAINAGE PONDS, FOOD SERVICE AREAS, PARKING LOT DRAINS, OR OTHER SENSITIVE AREAS.
- DISTANCES CAN VARY WITH SIZE OF EQUIPMENT DOORS, DOOR STOP ANGLE AND TYPE OF MAINTENANCE/OPERATION PROCEDURES NECESSARY TO MAINTAIN/OPERATE/REPLACE EQUIPMENT IN A SAFE MANNER.

◀ DENOTES LATEST REVISION

3			
2			
1	REM	11-4-04	MOVED TO MAKE 1-17, PG. 2
	NO. CK'D	DATE	REVISION

D. S. SUPR. *Bob Shinsky*
APPR. DATE 11-4-04
SUPERSEDES 1-18/11-17-93

INSTALLATION PROCEDURE FOR PROTECTIVE BOLLARDS USED WITH PAD-MOUNTED EQUIPMENT

▶ 1-20

TAMPA ELECTRIC CO.

STANDARDS

GENERAL RULES & SPECIFICATIONS UG.