


REFERENCES
GR&S UG STD. 11-3

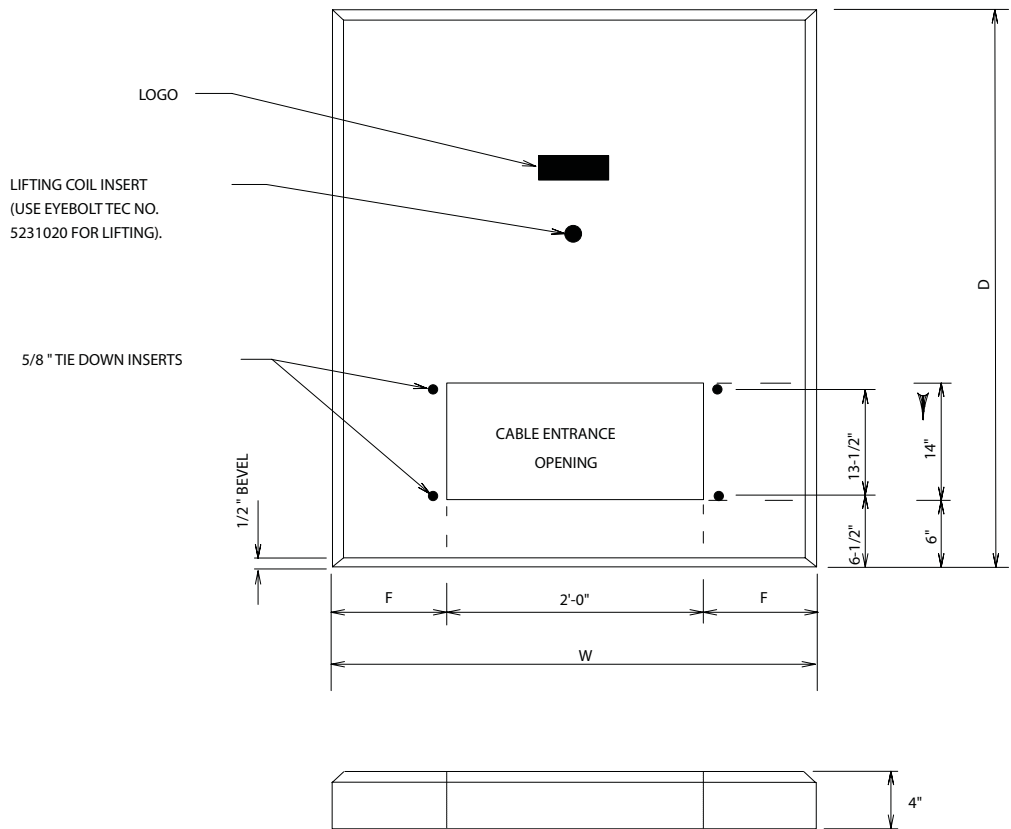

PAD	D	F	W	USE FOR TRANSFORMER SIZES
TEC NO. 2001001	45"	8"	40"	25-50 kVA
TEC NO. 2001002	52"	10"	44"	75-250 kVA

NOTES:

- ▶ TRANSFORMERS WITH STEEL LIDS SHALL BE BOLTED TO PAD USING 5/8" X 1-1/4" BOLTS (TEC NO. 5233050).

◀ DENOTES LATEST REVISION

3				
2				
1	MFK	11-4-04	REVISED NOTE, TABLE, REF. BLK., ADD 14"	
NO.	CKD	DATE	REVISION	

PAD DESIGN FOR		D. S. SUPPL. APRR. DATE <u>11-4-04</u> SUPERSEDES <u>6-11/7-20-00</u>
SINGLE-PHASE PAD-MOUNTED TRANSFORMERS		
TAMPA ELECTRIC CO.	STANDARDS	GENERAL RULES & SPECIFICATIONS UG.
		6-11