REFERENCES
GR&S UG. STD. 6-20 SEC. 4

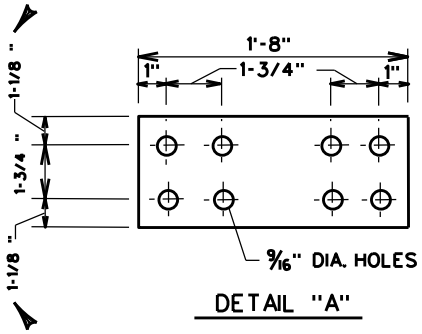

DETAIL "A"

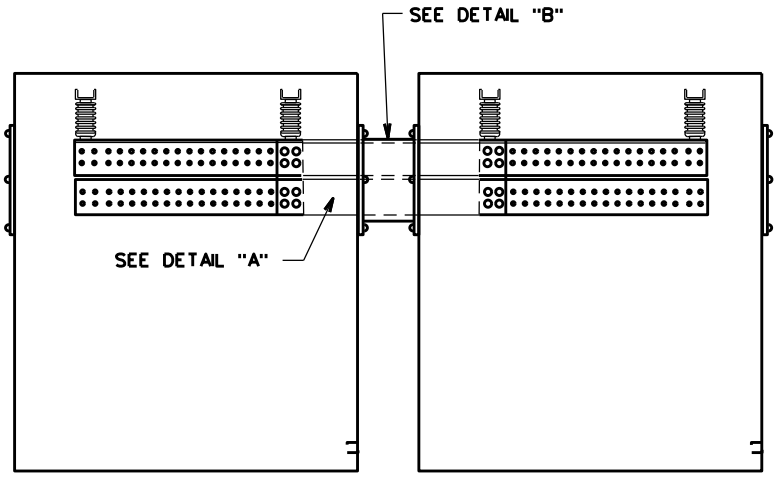

TWO PAD-MOUNTED SECONDARY TERMINATION CABINETS BUSED TOGETHER

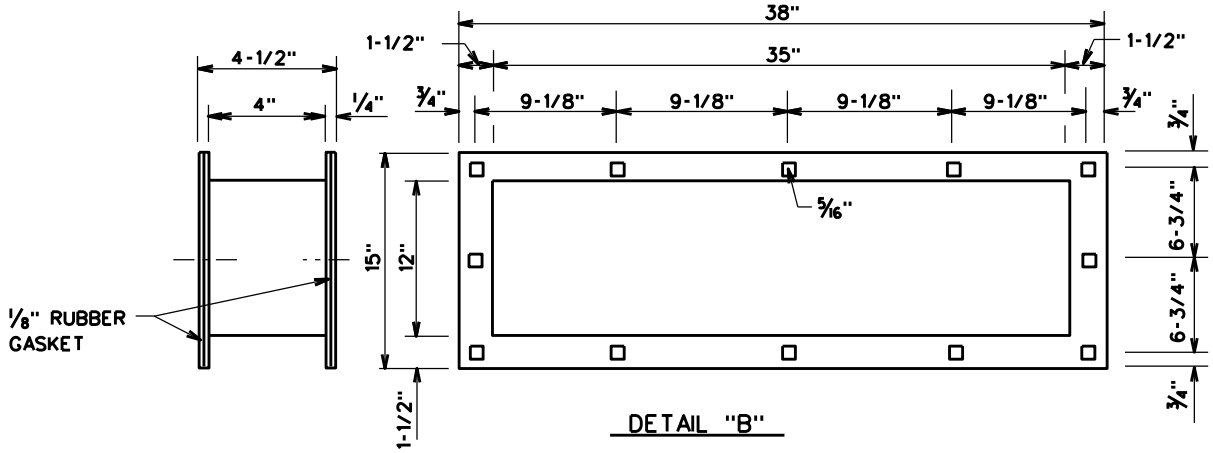

DETAIL "B"

NOTES:

1. USE TEC NO. 2004579 TO ORDER PAD-MOUNTED SECONDARY CABINET.
2. REMOVEABLE PANEL TO FACILITATE BUSSING CABINETS TOGETHER.
3. USE TEC NO. 2001326 PRECAST CONCRETE PAD FOR SINGLE PAD-MOUNTED SECONDARY CABINET. FOR MULTIPLE UNITS USE (2) PRECAST PADS OR IF UNAVAILABLE USE POURED IN PLACE PAD PER M-DRAWING M-458.
4. USE THROAT AND BUS MOUNTING KIT TEC NO. 2004619 FOR BUSSING CABINETS TOGETHER.
5. THE PAD-MOUNTED SECONDARY CABINET BUS BAR WILL ACCEPT AS MANY AS 30 CONDUCTORS PER PHASE. THE TWO POSITIONS ON EITHER END OF EACH BUS BAR SHOULD BE LEFT OPEN IN CASE FUTURE BUSSING OF ANOTHER UNIT IS REQUIRED. IF BUSSING OF MORE THAN ONE CABINET IS NOT EXPECTED THESE TWO POSITIONS MAY BE USED FOR CABLE TERMINATIONS INCREASING THE TOTAL CONDUCTORS PER PHASE TO 38.

◄ DENOTES LATEST REVISION

NO.	CK'D	DATE	REVISION
3			
2	SJH	2-18-10	CHANGED THIS PAGE TO 2 OF 3
1	LAC	3-19-09	REVISED & ADDED DIMENSIONS

Chip S. Whitworth
MGR: STD'S
APPR. DATE 2-18-10
SUPERSEDES 12-26/3-19-09

PAD-MOUNTED SECONDARY CABINET