


TOP VIEW

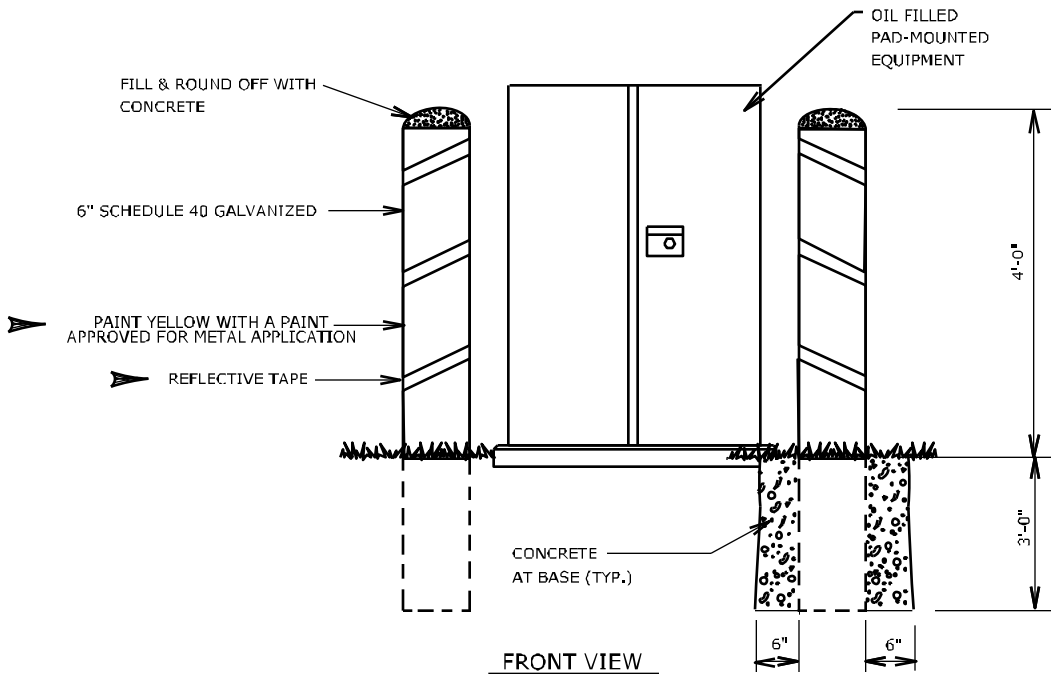

FRONT VIEW

NOTES:

1. UP TO 4 BOLLARDS SHOULD BE INSTALLED AROUND PERIMETER WHEN OIL FILLED PAD-MOUNTED EQUIPMENT IS LOCATED IN ANY AREA ACCESSIBLE TO VEHICLES FOR PROTECTION OF AREAS THAT COULD BECOME CONTAMINATED WITH MINERAL OIL SUCH AS : DRAINAGE PONDS, FOOD SERVICE AREAS, PARKING LOT DRAINS, OR OTHER SENSITIVE AREAS.
2. COORDINATE QUANTITY AND LOCATION OF BOLLARDS WITH TAMPA ELECTRIC. DISTANCES CAN VARY WITH SIZE OF EQUIPMENT DOORS, DOOR STOP ANGLE AND TYPE OF MAINTENANCE/OPERATION PROCEDURES NECESSARY TO MAINTAIN/OPERATE/REPLACE EQUIPMENT IN SAFE MANNER.

▲ DENOTES LATEST REVISION

INSTALLATION PROCEDURE FOR PROTECTIVE BOLLARDS USED WITH PAD-MOUNTED EQUIPMENT

| | | | |
|-------------------------------|---|---|-------------|
| TAMPA ELECTRIC COMPANY | STANDARD ELECTRICAL SERVICE REQUIREMENTS | DISTRIBUTION ENGINEERING 2200 E. SLIGH AVE TAMPA FL. 33610 PH. - (813) 275-3053 DATE EFFECTIVE: 8/18/22 | 7.56 |
|-------------------------------|---|---|-------------|