


REFERENCES	
GR&S UG.	
STD. 1-17	
STD. 1-43	
STD. 1-44	
STD. 11-1	



NOTES:

1. ALL STAKES TO BE INSTALLED BY DEVELOPER.
2. STAKES & GRADE REQUIRED EVERY 100' FOR CONDUIT TRENCH LINE, ON CURVED PORTIONS AT 25' INTERVALS, OR LESS IF REQUESTED.
3. STAKING REQUIRED FOR ALL TEC EQUIPMENT.
- ▶ 4. OFFSET STAKING REQUIRED FOR TEC EQUIPMENT - TRANSFORMERS, HANDHOLES, PULLBOXES, SWITCHGEAR/LBC.

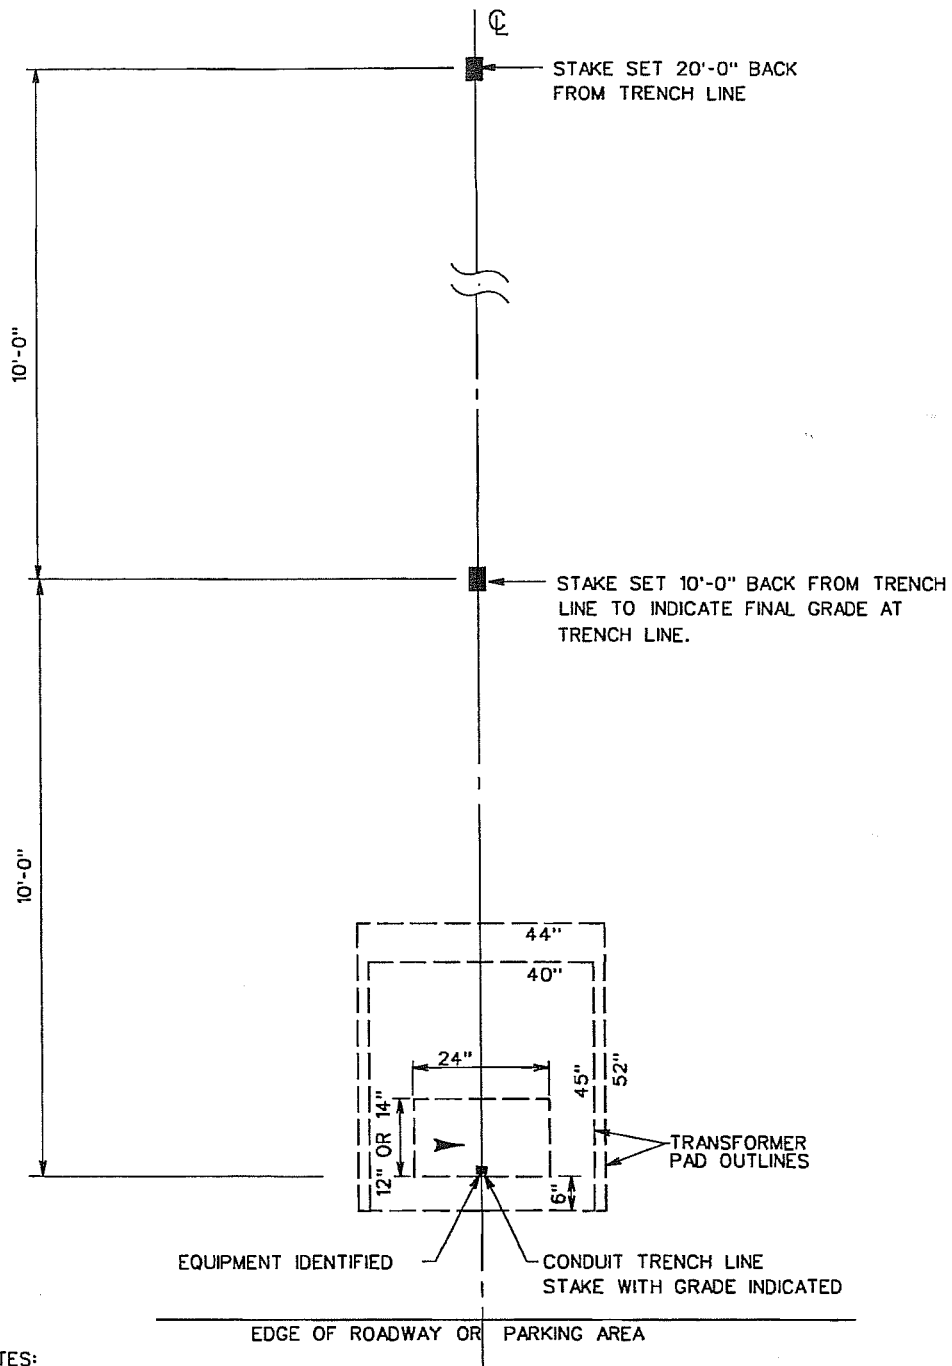

◀ DENOTES LATEST REVISION

NO.	CK'D	DATE	REVISION
4	MFK	8-18-05	REVISED REFERENCE BLOCK
3	MFK	8-18-05	REVISED NOTE 4 & REMOVED CONDUIT & S/L SYMBOL
2	CRM	10-16-03	TITLE CHANGE
1	REM	4-17-03	CLARITY ON STAKE LOCATION FROM EDGE OF WINDOW OF PAD

STAKING REQUIREMENTS FOR APARTMENTS AND COMMERCIAL ZERO LOT LINE APPLICATIONS

D.S. SUPR. *Bob Shively*
 APPR. DATE 8-18-05
 SUPERSEDES 1-46/10-16-03